



## Passive Smoking in a Displacement Ventilated Room

Bjørn, Erik; Nielsen, Peter V.

*Publication date:*  
1997

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*

Bjørn, E., & Nielsen, P. V. (1997). *Passive Smoking in a Displacement Ventilated Room*. Dept. of Building Technology and Structural Engineering. Indoor Environmental Technology Vol. R9714 No. 69

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### Take down policy

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.




---

# INSTITUTTET FOR BYGNINGSTEKNIK

DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITET • AAU • AALBORG • DANMARK

---

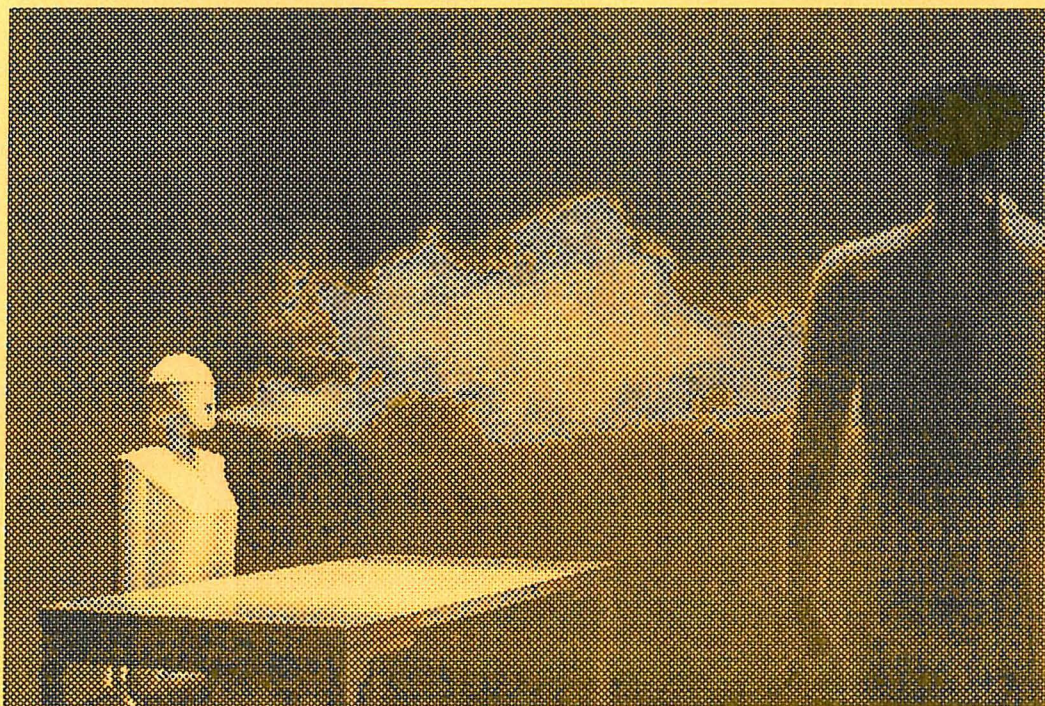

INDOOR ENVIRONMENTAL TECHNOLOGY  
PAPER NO. 69

Proceedings of Indoor Air '96, 7th International Conference on Air Quality  
and Climate, Nagoya, Japan

---

E. BJØRN & P. V. NIELSEN

PASSIVE SMOKING IN A DISPLACEMENT VENTILATED ROOM

JUNE 1997

ISSN 1395-7953 R9714

---



The papers on INDOOR ENVIRONMENTAL TECHNOLOGY are issued for early dissemination of research results from the Indoor Environmental Technology Group at the University of Aalborg. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible reference should be given to the final publications (proceedings, journals, etc.) and not to the paper in this series.

---

# INSTITUTTET FOR BYGNINGSTEKNIK

DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITET • AAU • AALBORG • DANMARK

---

INDOOR ENVIRONMENTAL TECHNOLOGY  
PAPER NO. 69

Proceedings of Indoor Air '96, 7th International Conference on Air Quality  
and Climate, Nagoya, Japan

---

E. BJØRN & P. V. NIELSEN

PASSIVE SMOKING IN A DISPLACEMENT VENTILATED ROOM

JUNE 1997

ISSN 1395-7953 R9714

---



# PASSIVE SMOKING IN A DISPLACEMENT VENTILATED ROOM

Erik Bjørn and Peter V. Nielsen

Department of Building Technology and Structural Engineering  
Aalborg University, Denmark

## ABSTRACT

The aim of this research is to see if the displacement ventilation principle can protect a person from exposure to passive tobacco smoking. This is done by full-scale experiments with two breathing thermal manikins, smoke visualisations, and tracer gas measurements. In some situations, exhaled smoke will stratify in a certain height due to the vertical temperature gradient. This horizontal layer of exhaled tobacco smoke may lead to exposure. In other situations, the smoke is mixed into the upper zone, and the passive smoker is protected to some extent by the displacement principle and the convective boundary layer flow around the body.


## INTRODUCTION

In a displacement ventilated room, the contaminant distribution is often assumed to be described by the two-zone model, ie. the room is divided into a lower, clean zone and an upper, polluted zone. Ideally, the air inhaled by occupants should come mainly from the lower, clean zone. The benefits of the system are high ventilation and temperature efficiencies. However, it is well known that the traditional two-zone model is only a rough approximation of the true concentration distribution. The inhaled concentration is lower than the ambient concentration in most cases, but not always. These subjects have been addressed by several workers, see eg. (Stymne et.al 1991), (Brohus et.al. 1996), (Mundt 1996). The aim of this research is to see if the displacement ventilation principle can protect a person from exposure to passive tobacco smoking. This means that the focus is on the human respiration. Exhaled air will rise due to its buoyancy. This is a very weak flow and may, similar to plumes, easily meet isothermal conditions in a displacement ventilated room, where a vertical temperature gradient is always present. According to (Hyltdgaard 1994) exhaled air has been observed to stratify in a certain height due to the temperature gradient. It is not clear if this stratification will always occur, or if it will result in larger exposure to contaminants. These are the main questions of this investigation.

## METHODS

This is an experimental study, carried out in a full-scale test room, ventilated by the displacement principle. The room is 8 m long, 6 m wide and 4.7 m high. The walls are made of 22 mm uninsulated plywood. The floor is insulated with 50 mm mineral wool. The surrounding laboratory is kept at 20-22 °C. Fresh air is supplied through a wall mounted, low velocity inlet device, and extracted through two circular openings (diameter 250 mm) in the ceiling (see figure 1). Human beings are simulated by two breathing, thermal manikins, which are described in more detail below. Two types of additional heat sources are used: 1) a so-called "person simulator" consisting of a steel cylinder (diameter 0.4 m, height 1.0 m), painted in a dull black colour, and with four light bulbs inside as heat source. This is the same type of person simulator as described in eg. (Kofoed et.al.1991). 2) a point source consisting of four heating coils shielded by a small,



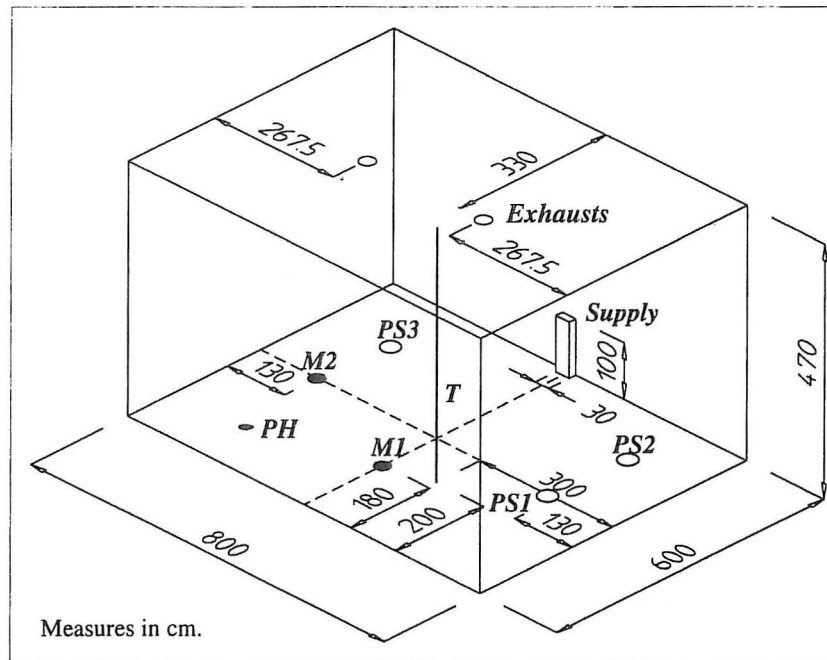

**Figure 1 :** Test room, situation of supply (S), exhausts (E), manikins (M), Person simulators (PS), Point heat source (PH).

blank steel cylinder (diameter 0.15 m, height 0.2 m, open in the top).

Two different fresh air supply rates are used, 160 m<sup>3</sup>/h and 400 m<sup>3</sup>/h, which corresponds to situations with respectively low and high stratification height. Different combinations of air supply rate and thermal load are chosen to produce different combinations of vertical temperature gradient and stratification height.

Four different setups of the room are investigated.

- 1) Air supply rate 400 m<sup>3</sup>/h, thermal load: M1, M2, PS1, PH.
- 2) Air supply rate 160 m<sup>3</sup>/h, thermal load: M1, M2, PS1, PH.
- 3) Air supply rate 400 m<sup>3</sup>/h, thermal load: M1, M2.
- 4) Air supply rate 160 m<sup>3</sup>/h, thermal load: M1, M2, PS1, PS2, PS3, PH.

Total heat effect of each heat source: M1: 75 W, M2: 100 W, PS: 100 W, PH: 500 W.

### Breathing thermal manikins

*Manikin no.1, "The Passive Smoker":* This manikin is developed at the Danish Technical University. It is shaped as a 1.7 m high average sized woman. The surface area is 1.47 m<sup>2</sup>. The tight fitting clothes have an insulation value of 0.8 clo. The manikin consists of a fibre armed polyester shell, wound with nickel wire used sequentially to measure the surface temperature and to heat the manikin to a specified skin temperature in 16 individual zones. The skin temperature and the heat output correspond to a person in thermal comfort.

*Manikin no.2, "The Smoker":* This manikin is developed by the first author of this paper. The external geometry of the manikin is designed to be as similar as possible to that of manikin no.1. The surface area is 1.44 m<sup>2</sup>. The manikin consists of a hollow aluminium shell. Inside it is equipped with two fans, forcing the air to circulate rapidly, and with 15 m of heating wire distributed evenly throughout the interior of the manikin, thus ensuring an even temperature distribution. The total heat effect supplied to the manikin can be controlled between 0 - 400 W.

The mouth, which is used for exhalation in these experiments (since this is typical of active smokers), consists of a circular opening (diameter 12 mm).

*Artificial lungs:* Both manikins are connected to artificial "lungs" that provide respiration through mouth and/or nose. An artificial "lung" consists simply of cylinder with a piston driven by an electric motor. This produces a pulsating, sinusoidal breathing, quite similar to reality. The chosen pulmonary ventilation is 6.0 liter/min, respiration frequency is  $10 \text{ min}^{-1}$ , corresponding to a person at rest.

The air flow pattern is visualised with smoke. Temperatures are measured with thermocouples (type K, accuracy  $\pm 0.15^\circ\text{C}$ ) and a data logger (type Fluke Helios 2287 A) connected to a PC. The contaminant distribution is studied by tracer gas measurements using Dinitrogenoxide ( $\text{N}_2\text{O}$ ) as tracer gas, and a gas analyser (type Brüel & Kjær 1302).  $\text{N}_2\text{O}$  is 44/29 times heavier than atmospheric air, but is considered appropriate as tracer gas for the following reasons: 1)  $\text{N}_2\text{O}$  is added to the air exhaled by a manikin to simulate exhaled tobacco smoke. At equal temperatures, exhaled air is heavier than air due to the content of  $\text{CO}_2$  and water vapour. The concentrations of  $\text{N}_2\text{O}$  in the exhalation (ca.4%) are close to the natural concentration of  $\text{CO}_2$  in exhalation air. 2) The excess temperature is of greater importance to the flow of the exhaled air than the above-mentioned differences in molecular weight. The exhaled air is heated to  $32^\circ\text{C}$ , which is the temperature of exhaled air from human beings (Cole 1982). The room air is  $20\text{--}22^\circ\text{C}$ .

## RESULTS

### Stratification heights

In all four experimental setups, the stratification height  $y_{st}$  that would result from the pollution source being simultaneously a heat source (as often assumed when dealing with displacement ventilation) is found by adding tracer gas above a heat source (preferably the point source) at a height of 2 m (see figure 2). The measured concentration  $c$  is made dimensionless by the return concentration  $c_R$ . The dimensionless concentration profile (see figure 2) does not necessarily show all the typical two-zone-model characteristics. There can be both vertical and horizontal concentration gradients inside the two zones due to eg. downdraft at the walls.



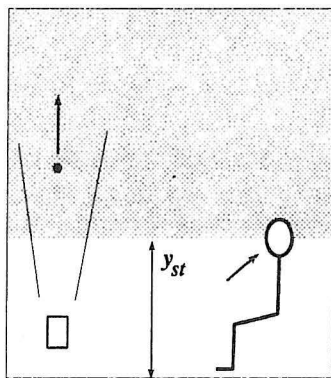


Figure 2 + 3: Estimation of  $y_{st}$




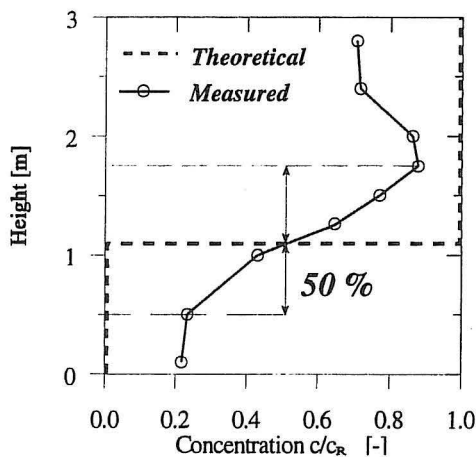

## Temperatures

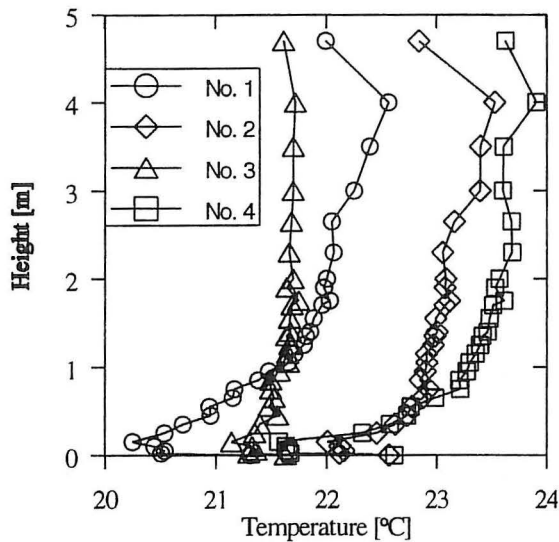

**Figure 4 :** Vertical temperatur profile for exp. 1-4.

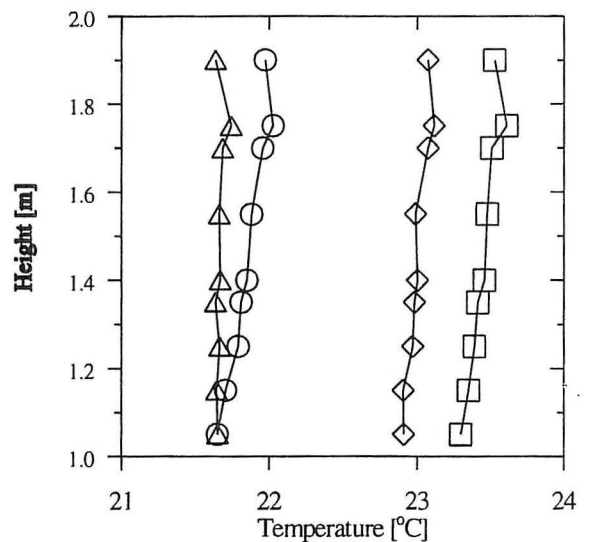

**Figure 5 :** Vertical temperature profiles, height 1- 2m.

Due to the uninsulated walls of the test room, it was difficult to produce vertical temperature gradients with much difference. The gradients in the area of most interest (1-2 m) vary between 0.0 - 0.5 °C/m. (Exp. No.1: 0.5 °C/m, No.2: 0.3 °C/m, No.3: 0.0 °C/m, No.4: 0.4 °C/m) In real life, vertical temperature gradients will often be larger (Up to ca. 1.0 °C/m).



## Smoke visualizations

In all experiments, the flow pattern is visualised with smoke. This is illustrated with a photo for experiment no.1. The other visualisations are shown as schematic drawings in the following.





**Figure 6 :** Smoke visualisation in experiment no.1: Stratification of exhaled air.

## Tracer gas measurements and smoke observations

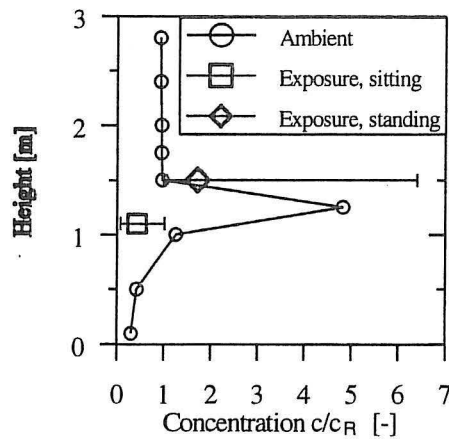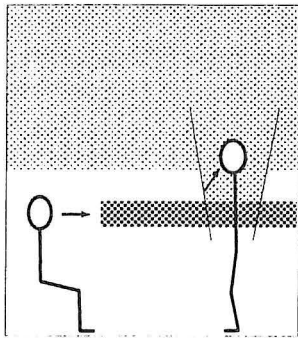



### Experiment no. 1

*Pictures to the left:*  
Light gray area shows  $y_{st}$  estimated by the method described in the above.  
Dark gray area shows smoke observation.

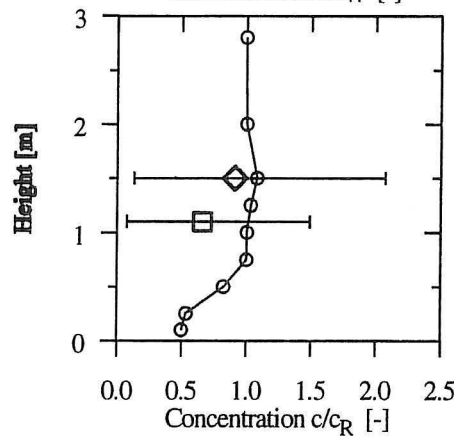
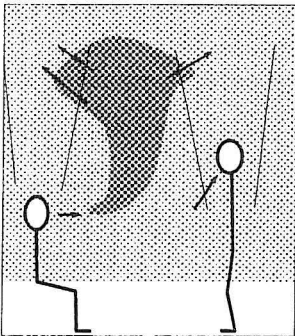


### Experiment no. 2

*Pictures to the right:*  
All symbols as in exp.no.1.  
Concentrations are made dimensionless by dividing with return concentration  $c_R$ . The horizontal lines show the full range of exposure measurements, from minimum to maximum.

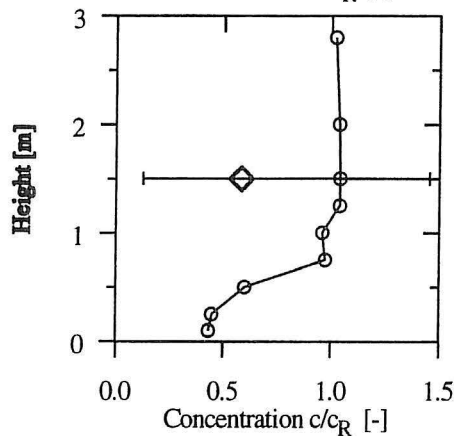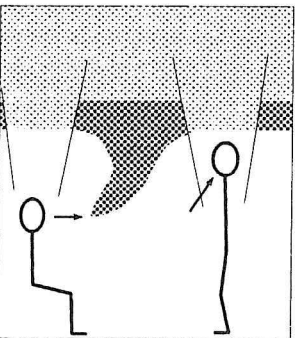

### Experiment no. 3

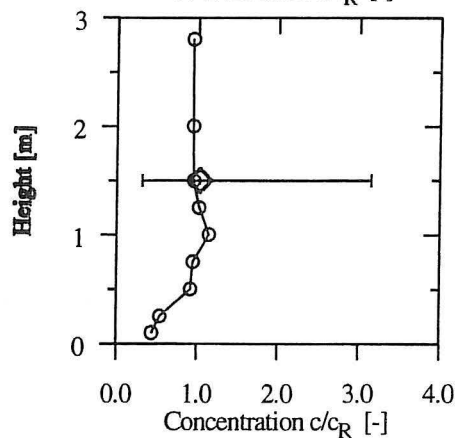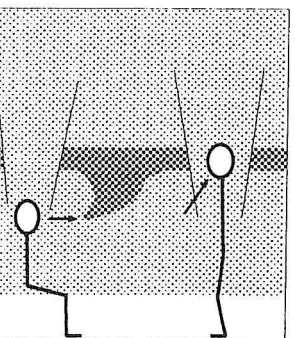

### Experiment no. 4

## DISCUSSION

In these experiments, it is demonstrated that the exhalation flow may stratify because of density differences, and that high concentrations can occur in the breathing zone. In (exp.1, standing) the exposure is much larger than one would usually expect. The convective boundary layer close to the human body modifies the concentration field locally, so that the inhaled concentration is different from the ambient concentration at the same height. If the exhalation is to give rise to unusually high levels of exposure, the stratified layer must be situated below breathing height (Exp.1, standing). In other cases, the stratified exhalation flow will be entrained by plumes from other heat sources, and this will ensure mixing of the stratified flow into the entire upper zone. Many heat sources will generally give rise to effective mixing.

The vertical temperature gradient is assumed to play a role with regard to the stratification height of the exhalation. It seems that a steep gradient means low stratification height. In many practical situations, the gradient will be steeper than in these experiments. This probably means that stratification of exhalation will occur at low height, thus reducing the effectiveness of the system. However, this is only indicated by the present research.

The absolute temperature difference between the exhaled air and the room air was not exactly the same in all experiments. This did not have any obvious effect on the results, indicating that the flow pattern is not sensitive to minor deviations of this parameter.

The results may be distorted by downdraft at walls. Furthermore, the exhalation is a very weak flow, so the stratification height is sensible to small changes in temperature gradients, and there may also be density differences between paraffin smoke and tracer gas. There may be horizontal gradients with regard to temperatures and concentrations, and these are only measured at one horizontal locality. Finally, the smoke observations only cover a very short period of time, while the tracer gas measurements are taken for many hours.

One can not be sure that tobacco smoke will behave in exactly the same way as the tracer gas. The tobacco smoke contains a multitude of particles and gases, which do not necessarily all behave alike with regard to the buoyant forces. The "smoking behaviours" of individual smokers are not taken into account, and the "sidestream" of smoke from cigarettes is not considered. Thus, the present experiments are not intended to reproduce in every detail, say, a smoking lounge, but rather to demonstrate some interesting properties which must be taken into account.

## ACKNOWLEDGEMENTS

This research was supported financially by the Danish Technical Research Council (STVF) as part of the research programme "Healthy Buildings", 1993 - 97.

## REFERENCES

- H. Stymne, M.Sandberg, M.Mattsson 1991.** *Dispersion of contaminants in a displacement ventilated room - implications for demand control.* 12th AIVC Conference, Ottawa.
- H.Brohus, P.V.Nielsen 1996.** *Personal exposure in displacement ventilated rooms.* Accepted for publication in *Indoor Air*, Munksgaard, Copenhagen.
- E.Mundt 1996.** *The performance of displacement ventilation systems.* Royal Institute of Technology, Sweden.
- C.E.Hyldgaard 1994.** *Humans as a source of heat and air pollution.* ROOMVENT '94, Krakow.
- P.Kofoed, P.V.Nielsen 1990.** Thermal plumes in ventilated rooms. ROOMVENT '90, Oslo.
- Philip Cole 1982.** Chap.14 in: *Proctor/Andersen (eds), The Nose: Upper airway physiology and the atmospheric environment.* Elsevier Biomedical Press.



## PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 35: P. Heiselberg: *Draught Risk from Cold Vertical Surfaces*. ISSN 0902-7513 R9338.

PAPER NO. 36: P. V. Nielsen: *Model Experiments for the Determination of Airflow in Large Spaces*. ISSN 0902-7513 R9339.

PAPER NO. 37: K. Svidt: *Numerical Prediction of Buoyant Air Flow in Livestock Buildings*. ISSN 0902-7513 R9351.

PAPER NO. 38: K. Svidt: *Investigation of Inlet Boundary Conditions Numerical Prediction of Air Flow in Livestock Buildings*. ISSN 0902-7513 R9407.

PAPER NO. 39: C. E. Hyldgaard: *Humans as a Source of Heat and Air Pollution*. ISSN 0902-7513 R9414.

PAPER NO. 40: H. Brohus, P. V. Nielsen: *Contaminant Distribution around Persons in Rooms Ventilated by Displacement Ventilation*. ISSN 0902-7513 R9415.

PAPER NO. 41: P. V. Nielsen: *Air Distribution in Rooms - Research and Design Methods*. ISSN 0902-7513 R9416.

PAPER NO. 42: H. Overby: *Measurement and Calculation of Vertical Temperature Gradients in Rooms with Convective Flows*. ISSN 0902-7513 R9417.

PAPER NO. 43: H. Brohus, P. V. Nielsen: *Personal Exposure in a Ventilated Room with Concentration Gradients*. ISSN 0902-7513 R9424.

PAPER NO. 44: P. Heiselberg: *Interaction between Flow Elements in Large Enclosures*. ISSN 0902-7513 R9427.

PAPER NO. 45: P. V. Nielsen: *Prospects for Computational Fluid Dynamics in Room Air Contaminant Control*. ISSN 0902-7513 R9446.

PAPER NO. 46: P. Heiselberg, H. Overby, & E. Bjørn: *The Effect of Obstacles on the Boundary Layer Flow at a Vertical Surface*. ISSN 0902-7513 R9454.

PAPER NO. 47: U. Madsen, G. Aubertin, N. O. Breum, J. R. Fontaine & P. V. Nielsen: *Tracer Gas Technique versus a Control Box Method for Estimating Direct Capture Efficiency of Exhaust Systems*. ISSN 0902-7513 R9457.

PAPER NO. 48: Peter V. Nielsen: *Vertical Temperature Distribution in a Room with Displacement Ventilation*. ISSN 0902-7513 R9509.

PAPER NO. 49: Kjeld Svidt & Per Heiselberg: *CFD Calculations of the Air Flow along a Cold Vertical Wall with an Obstacle*. ISSN 0902-7513 R9510.

PAPER NO. 50: Gunnar P. Jensen & Peter V. Nielsen: *Transfer of Emission Test Data from Small Scale to Full Scale*. ISSN 1395-7953 R9537.

PAPER NO. 51: Peter V. Nielsen: *Healthy Buildings and Air Distribution in Rooms*. ISSN 1395-7953 R9538.

PAPER NO. 52: Lars Davidson & Peter V. Nielsen: *Calculation of the Two-Dimensional Airflow in Facial Regions and Nasal Cavity using an Unstructured Finite Volume Solver*. ISSN 1395-7953 R9539.



## PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 53: Henrik Brohus & Peter V. Nielsen: *Personal Exposure to Contaminant Sources in a Uniform Velocity Field*. ISSN 1395-7953 R9540.

PAPER NO. 54: Erik Bjørn & Peter V. Nielsen: *Merging Thermal Plumes in the Indoor Environment*. ISSN 1395-7953 R9541.

PAPER NO. 55: K. Svidt, P. Heiselberg & O. J. Hendriksen: *Natural Ventilation in Atria - A Case Study*. ISSN 1395-7953 R9647.

PAPER NO. 56: K. Svidt & B. Bjerg: *Computer Prediction of Air Quality in Livestock Buildings*. ISSN 1395-7953 R9648.

PAPER NO. 57: J. R. Nielsen, P. V. Nielsen & K. Svidt: *Obstacles in the Occupied Zone of a Room with Mixing Ventilation*. ISSN 1395-7953 R9649.

PAPER NO. 58: C. Topp & P. Heiselberg: *Obstacles, an Energy-Efficient Method to Reduce Draught from Large Glazed Surfaces*. ISSN 1395-7953 R9650.

PAPER NO. 59: L. Davidson & P. V. Nielsen: *Large Eddy Simulations of the Flow in a Three-Dimensional Ventilated Room*. ISSN 1395-7953 R9651.

PAPER NO. 60: H. Brohus & P. V. Nielsen: *CFD Models of Persons Evaluated by Full-Scale Wind Channel Experiments*. ISSN 1395-7953 R9652.

PAPER NO. 61: H. Brohus, H. N. Knudsen, P. V. Nielsen, G. Clausen & P. O. Fanger: *Perceived Air Quality in a Displacement Ventilated Room*. ISSN 1395-7953 R9653.

PAPER NO. 62: P. Heiselberg, H. Overby & E. Bjørn: *Energy-Efficient Measures to Avoid Draught from Large Glazed Facades*. ISSN 1395-7953 R9654.

PAPER NO. 63: O. J. Hendriksen, C. E. Madsen, P. Heiselberg & K. Svidt: *Indoor Climate of Large Glazed Spaces*. ISSN 1395-7953 R9655.

PAPER NO. 64: P. Heiselberg: *Analysis and Prediction Techniques*. ISSN 1395-7953 R9656.

PAPER NO. 65: P. Heiselberg & P. V. Nielsen: *Flow Element Models*. ISSN 1395-7953 R9657.

PAPER NO. 66: Erik Bjørn & P. V. Nielsen: *Exposure due to Interacting Air Flows between Two Persons*. ISSN 1395-7953 R9658.

PAPER NO. 67: P. V. Nielsen: *Temperature Distribution in a Displacement Ventilated Room*. ISSN 1395-7953 R9659.

PAPER NO. 68: G. Zhang, J. C. Bennetsen, B. Bjerg & K. Svidt: *Analysis of Air Movement Measured in a Ventilated Enclosure*. ISSN 1395-7953 R9660.

PAPER NO. 69: E. Bjørn, P. V. Nielsen: *Passive Smoking in a Displacement Ventilated Room*. ISSN 1395-7953 R9714.

Department of Building Technology and Structural Engineering  
Aalborg University, Sohngaardsholmsvej 57. DK 9000 Aalborg  
Telephone: +45 9635 8080 Telefax: +45 9814 8243